


-15kV TOF: -9116 v  
 -3.6kV MCP: -2578 v  
 -2.4kV MCP: -1579 v  
 Input Cur: 308 ma  
 RPA max: 237 v  
 Mirror max: 238 v

Mon Feb 2 13:15:16 2004

## TIDE Direct Events

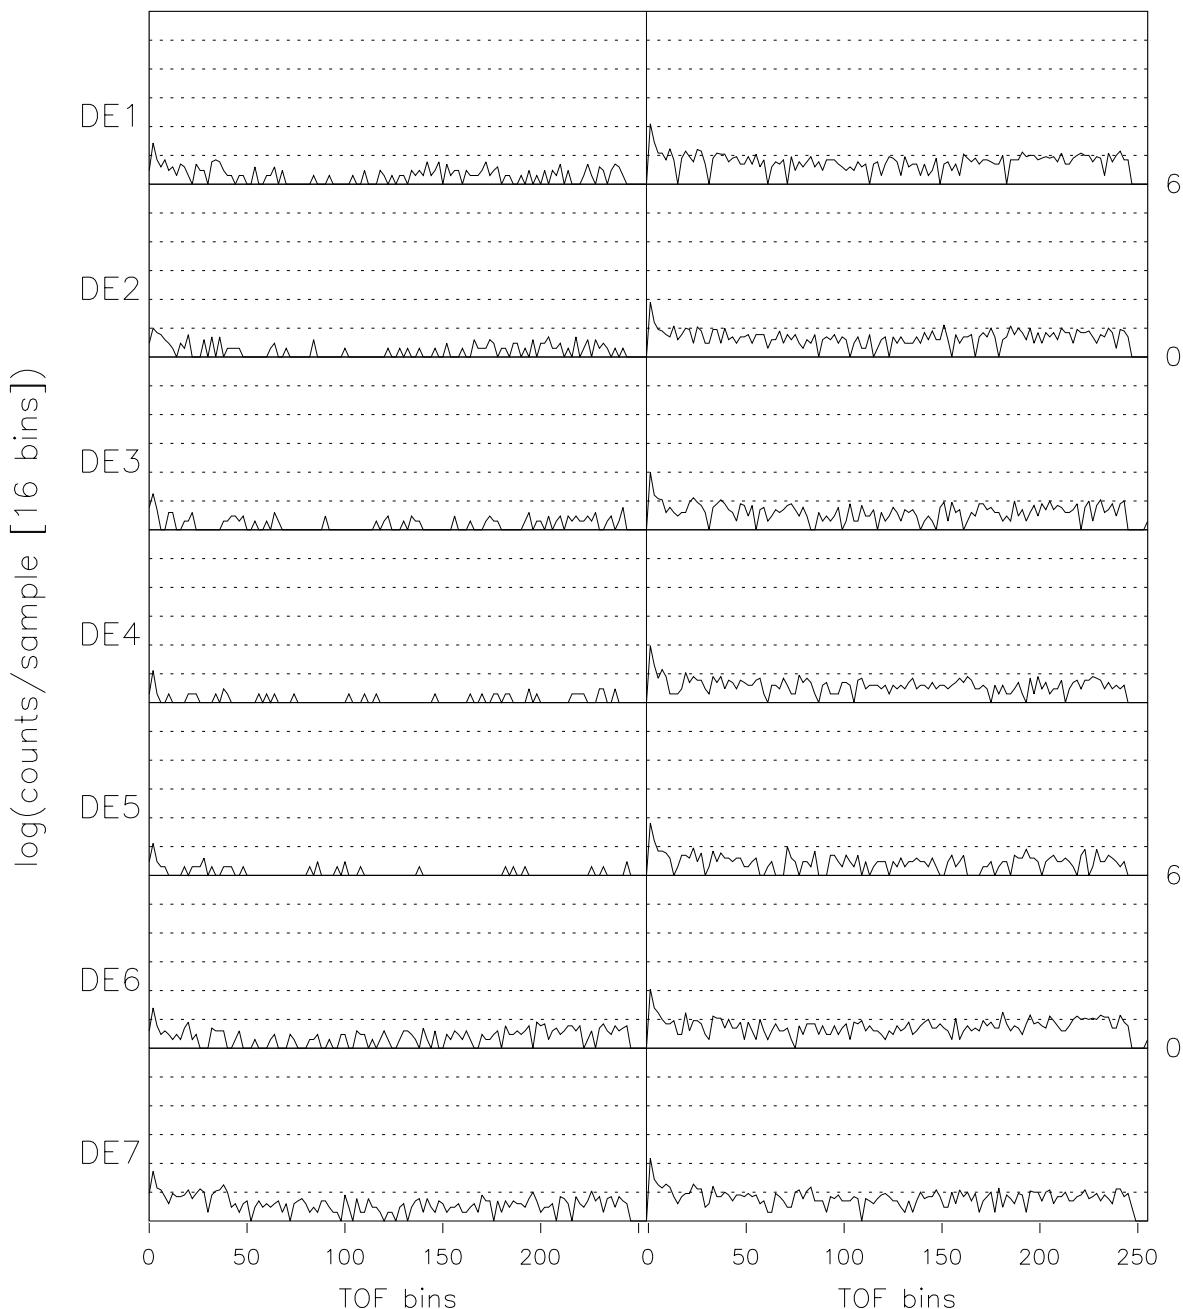

reported: 02-14-97 13:04:55 UT

reported: 02-14-97 13:08:07 UT

file: /export/data/tide/nrt/97021401.dat

-15kV TOF: -9116 v  
-3.6kV MCP: -2578 v  
-2.4kV MCP: -1589 v  
Input Cur: 296 ma  
RPA max: 237 v  
Mirror max: 238 v