


-15kV TOF: -9116 v
 -3.6kV MCP: -2578 v
 -2.4kV MCP: -1589 v
 Input Cur: 290 ma
 RPA max: 237 v
 Mirror max: 238 v

Wed Jan 21 07:13:47 2004

TIDE Direct Events

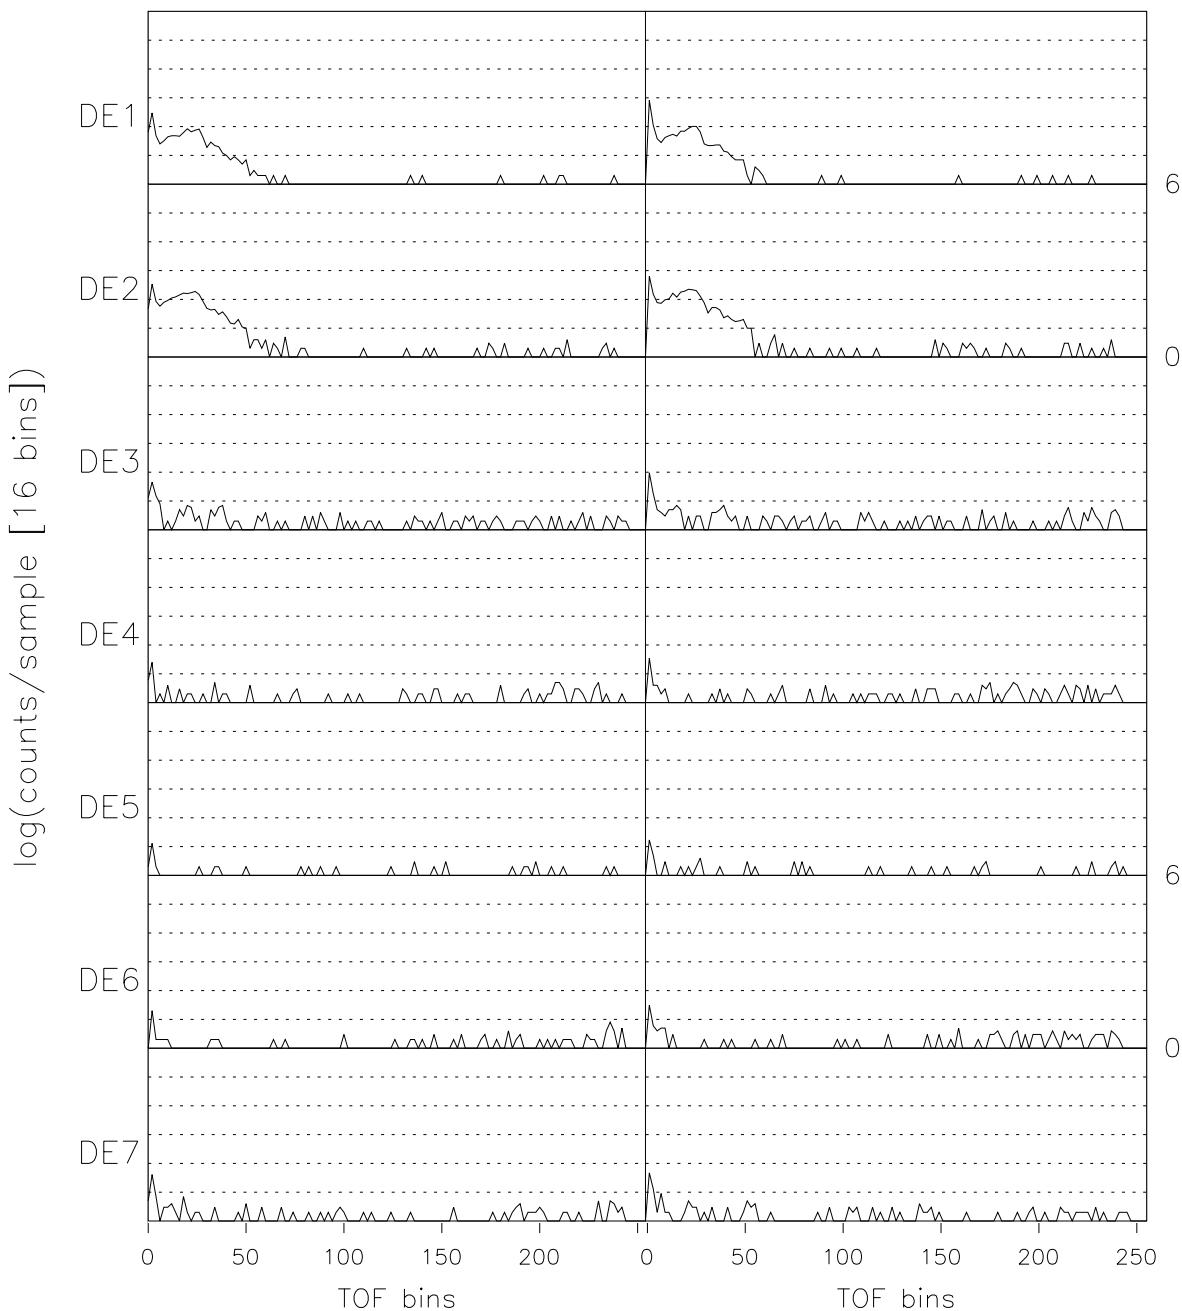

reported: 02-19-97 12:36:07 UT

reported: 02-19-97 12:39:19 UT

file: /export/data/tide/nrt/97021901.dat

-15kV TOF: -9116 v

-3.6kV MCP: -2578 v

-2.4kV MCP: -1579 v

Input Cur: 302 ma

RPA max: 237 v

Mirror max: 238 v